


Typical Section: Medium Duty Parking Lot

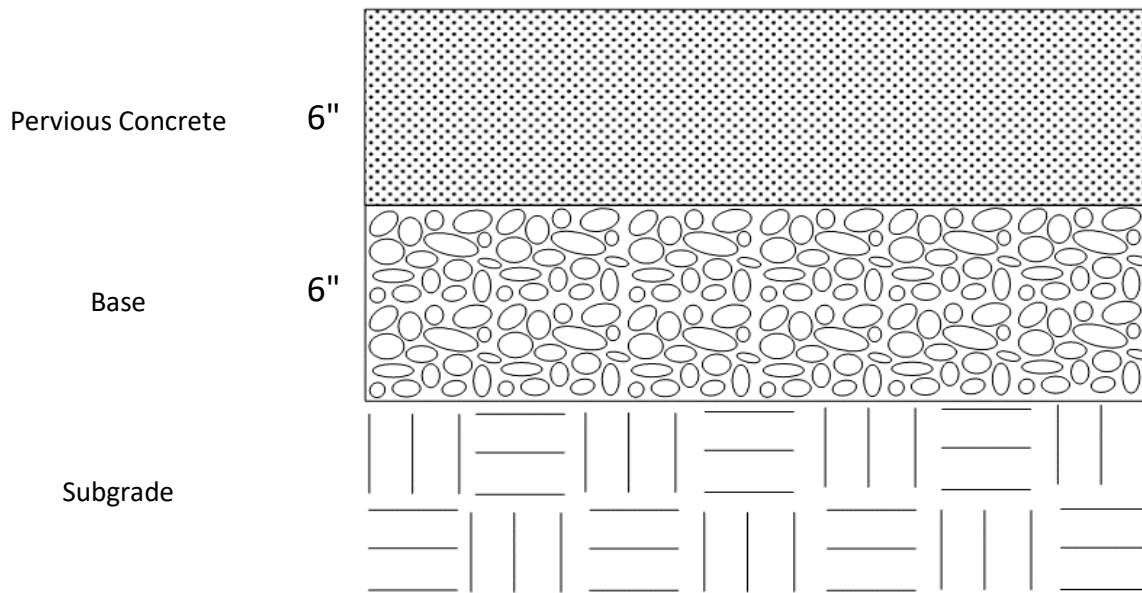

Base: Open graded crushed rock with min 35% voids, i.e:
 3/4" crushed drain rock/ ASTM #57 stone/ Caltrans Class I type B permeable.
 If more than 6", use aggregate described above for top 3" over ASTM #2 or similar.
 Make two passes with vibratory plate or roller. Adjust grade as needed.
 Shall be flat for maximum performance.
 Section thickness may be adjusted based on Geotech report.

Subgrade:
 Shall be flat for maximum performance.
 88- 92% compaction. Over compaction reduces soil infiltration capacity.
 If overcompacted from heavy equipment traffic, scarify and recompact top 6".
 Geotextile fabric over high plasticity soils and or slopes greater than 6%.

**For pavements receiving runoff from adjacent areas please consult BAPC.